



vzw - AIB-VINÇOTTE Belgium - asbl

Exploitatiezetel: Jan Olieslagerslaan 35 • 1800 Vilvoorde
Tel +32(0)2 674 57 11 • fax +32(0)2 674 59 59 • info@vincotte.be • www.vincotte.com
Maatschappelijke zetel: Diamant Building • Boulevard A. Reyerslaan 80 • B-1030 Brussel
Safety, quality and environmental services

Verslag nr.: P03792-10/11/95M



N 195058

Antwerpen-Limburg tel.: 03 221 86 11 Oost & West -Vlaanderen tel.: 09 244 77 11
Brabant tel.: 02 674 57 11 Wallonië tel.: 081 432 611

Resi code:



PROCES-VERBAAL VAN GELIJKVORMIGHEIDSONDERZOEK EN/OF CONTROLEBEZOEK VAN EEN ELEKTRISCHE LAAGSPANNINGSINSTALLATIE

Verantwoordelijke voor de werken:

Installatie:

Eigenaar of beheerder:

Form with fields for Name, Address, Post number, and Telephone number, filled with handwritten data.

Basis van het onderzoek: Algemeen Reglement op de Elektrische Installaties (AREI)

Form with checkboxes for various electrical codes and types of installations, such as Art 270, 271, 276, etc.

Algemene gegevens elektrische installatie:

Form with fields for EAN, kWh meter, protection type, voltage, current, and conductor details.

Metingen - testen - controles - verzegeling:

Form with checkboxes for testing procedures like direct/indirect contact, insulation level, and sealing.

Inbreuken - Opmerkingen (voor de betekenis van eventuele codes: zie keerzijde)

Table with columns for Inbreuken (New/Existing installation) and Opmerkingen (Remarks), containing handwritten notes.

Besluit(en):

Form with checkboxes for the status of the installation (new/existing) and whether it complies with AREI.

De installatie dient opnieuw gecontroleerd te worden vóór

Form with a date field for the next control, filled with 6/11/2016.

Agent bezoeker:

Form with fields for Agent Name (CHRISTIAEM), Agent Number (3792), and Date (6/11/2016).


Voor de directeur generaal: Handtekening

Form with checkboxes for attachments like situational and wiring diagrams.


- List of notes and instructions regarding the report, including preservation, safety, and follow-up actions.

Yzermonde
Barkas 600 / 7625
8620 Nieuwpoort

40A
30mA



elektro gantois
bulskampstraat 104
8630 Veurne
0495/232447

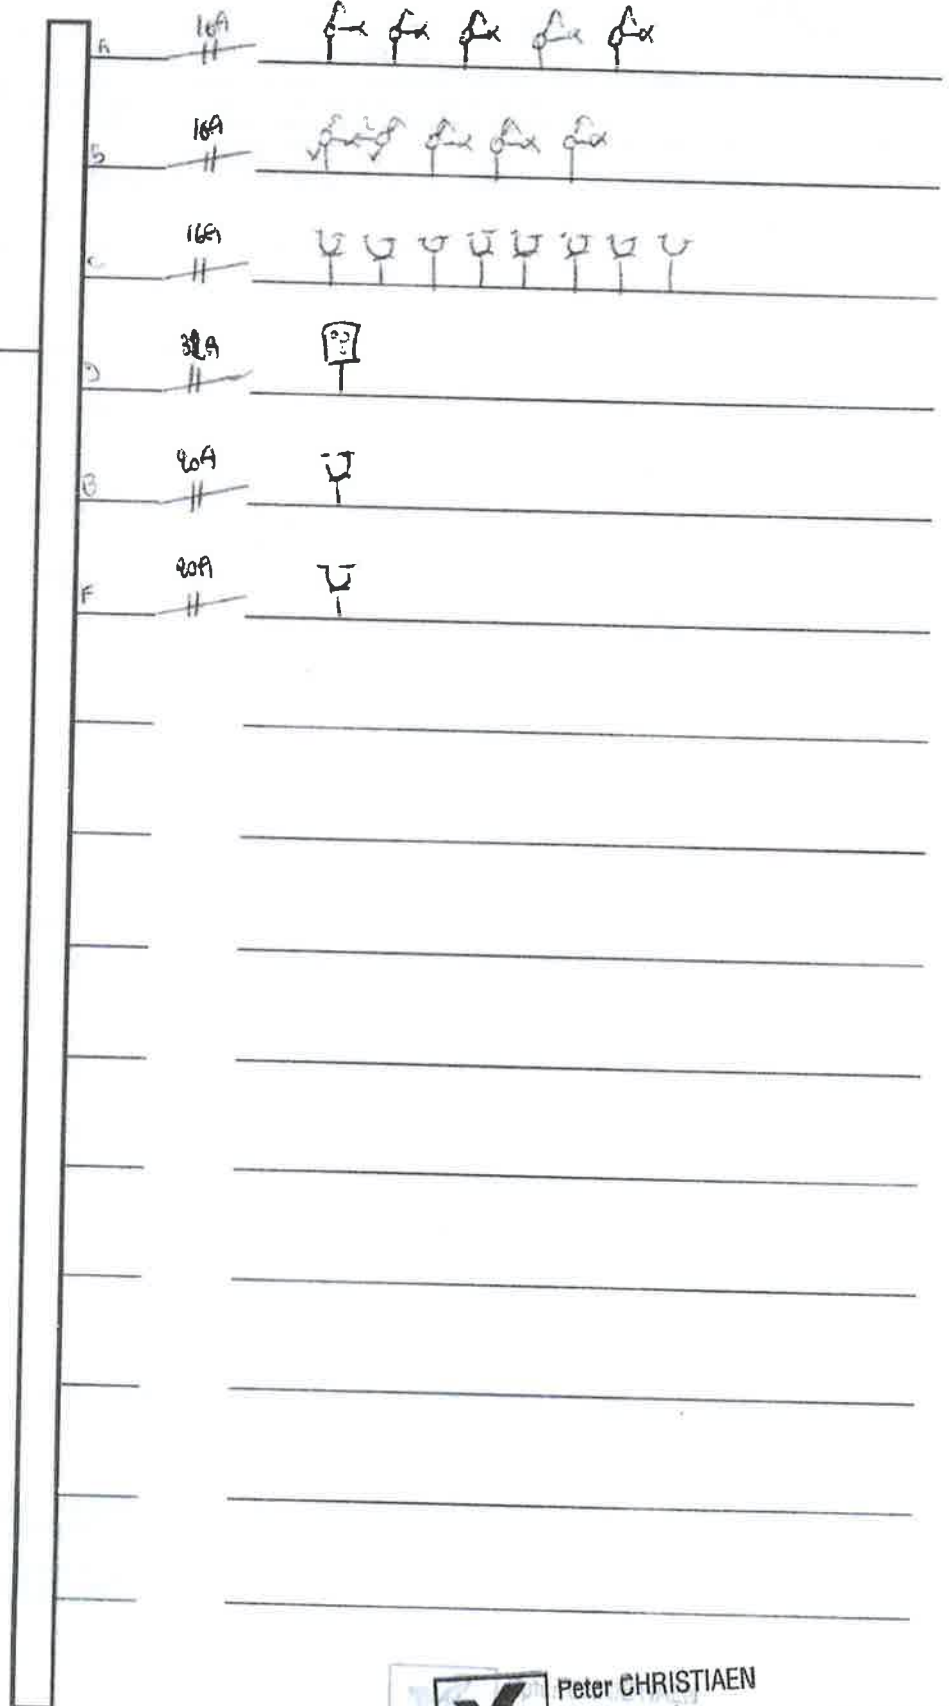


Peter CHRISTIAEN
Inspecteur
3792 3792

[Handwritten signature]

6/4/2011

113

Batterij 025

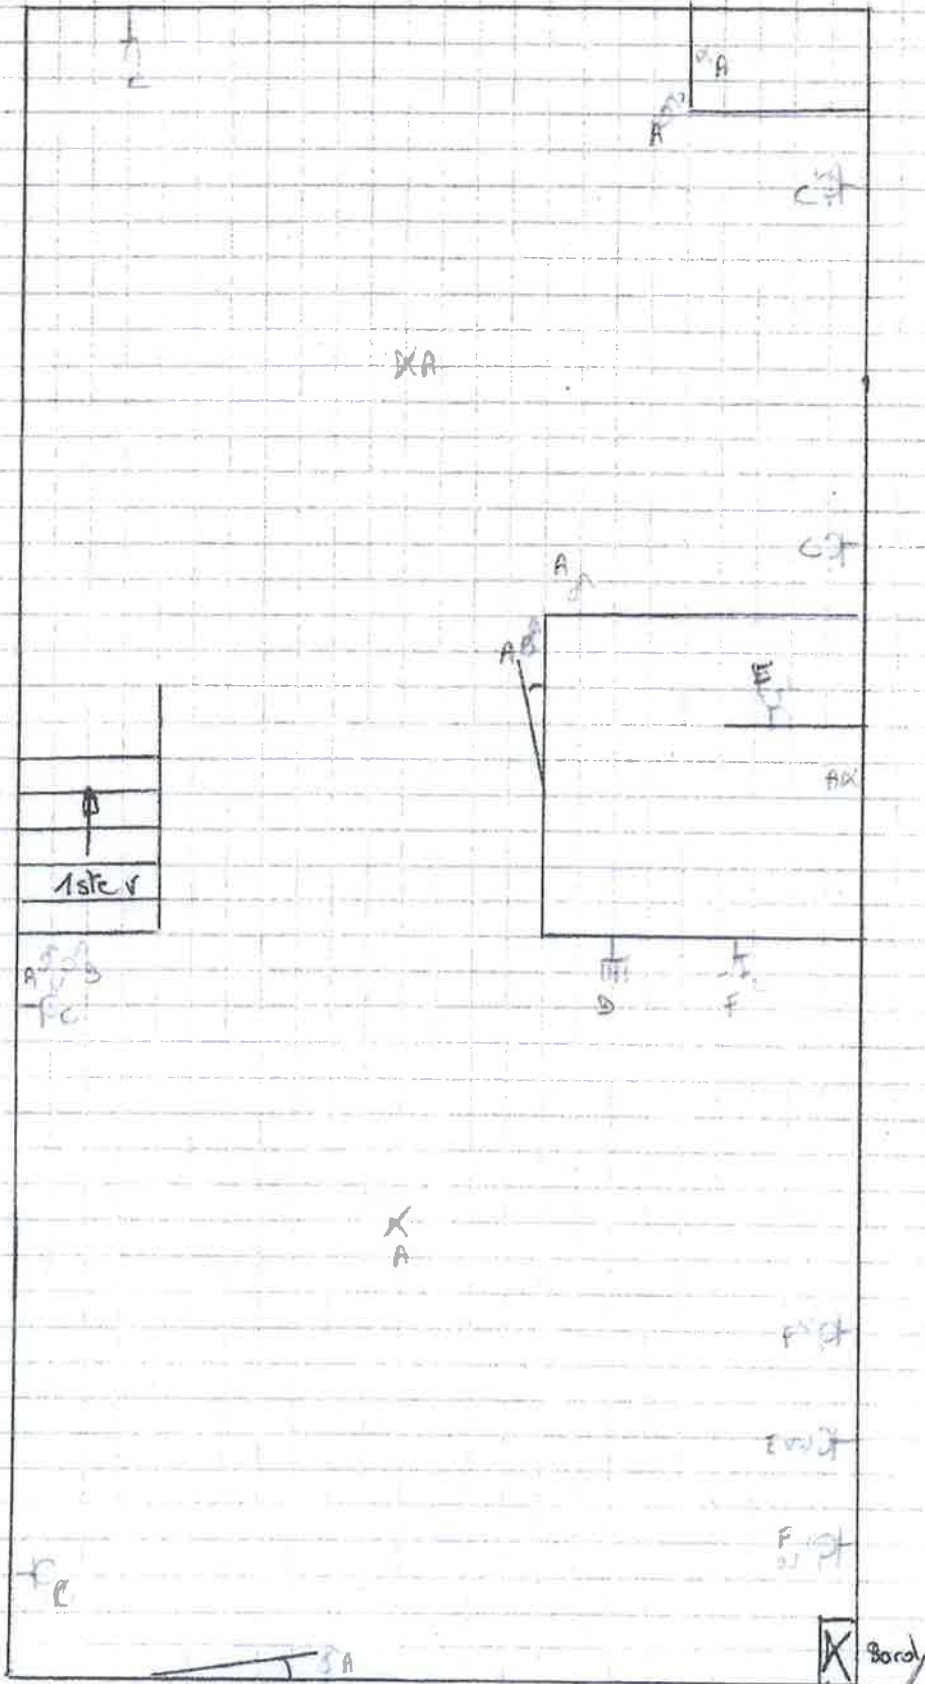

gelykvloers

ingang.




Peter CHRISTIAEN
Inspecteur
3792

ELEKTRO. GANTOIS b.v.b.a.
Bulskampstraat 104 - 8630 VEURNE
tel. 058/31 19 51 - 31 50 22
fax 058/31 59 21

2/3

Benken 625

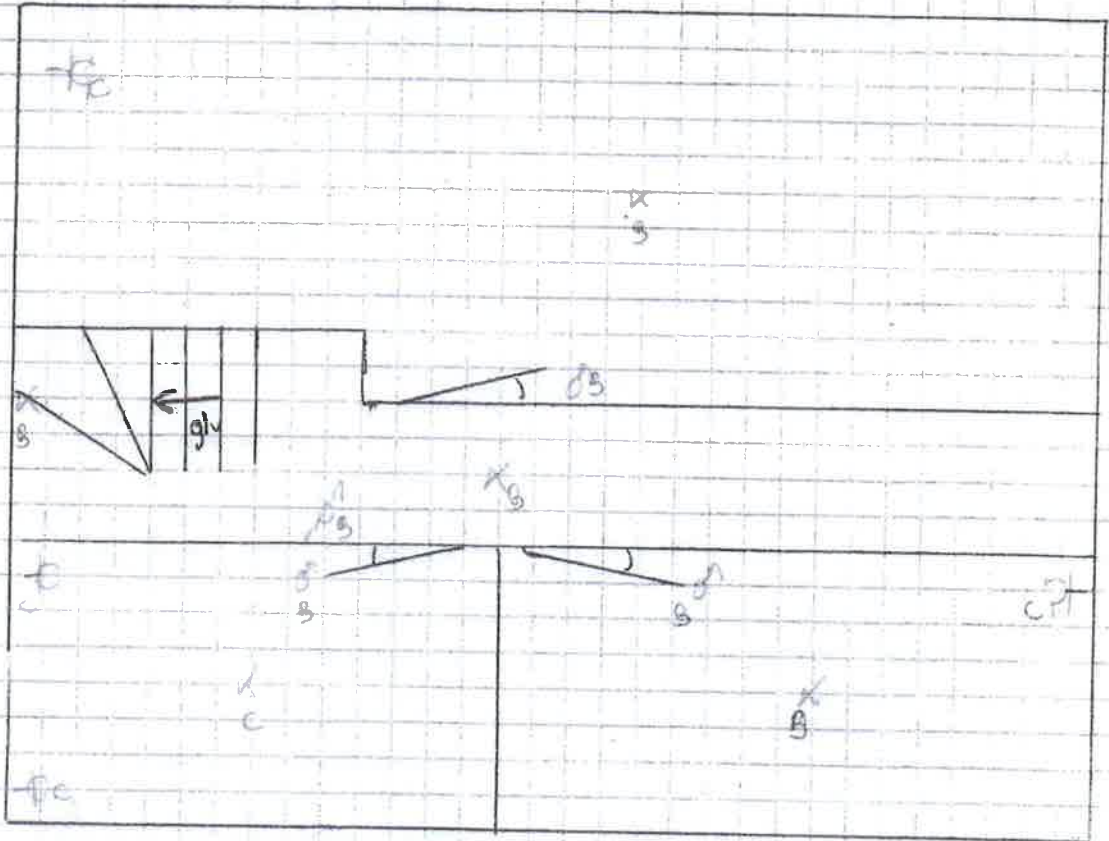

1ste verdieping

ELEKTRO GANTOIS b.v.b.a.
Bulskampstraat 104 - 3630 VEURNE
tel. 058/31 19 51 - 31 50 22
fax 058/31 59 21



Peter CHRISTIAEN
Inspecteur
3792